




Freeze Prevention Procedures for Outdoor PVB's

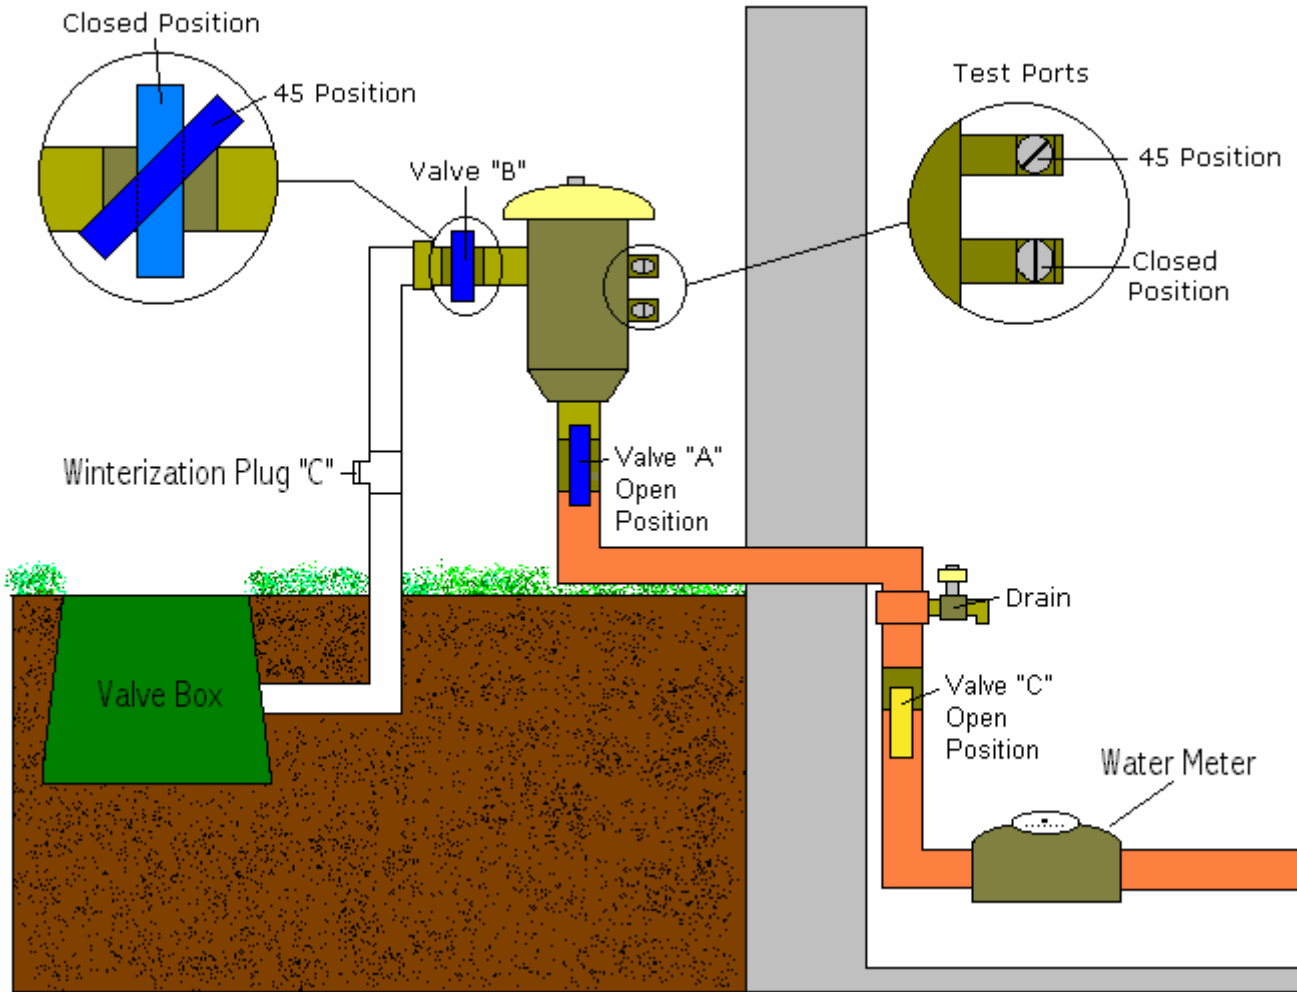

PVB Freeze Prevention Procedures:

1. Go to control clock and start manual cycle.
2. Close Valve "C".
3. Position Valves "A" and "B" to the 45 degree position.
4. Using a flat screwdriver, turn the Test Ports to the 45 degree position.
5. Open Drain, allow water to completely drain into bucket. Leave Drain open.
6. After control clock has completed manual cycle, turn controller to off position.

Only a complete winterization by Lipetzky's Irrigation can prevent your entire system from freeze damage.